



	Kurs	Sikring	Kabel	Beskrivelse
--	------	---------	-------	-------------

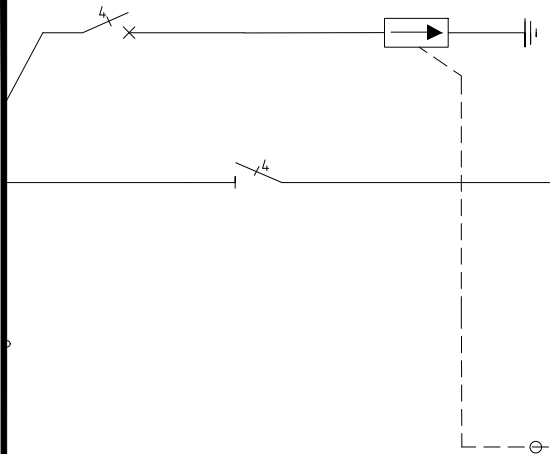

XQ00	B6A 4P		Over spenningsavleder pluggbare overspenningsvern
------	-----------	--	--


XS01	Lastbr. 125A 4P	=432.001-KW05 4X50/16 Al	Fra hovedford. 432.001 Nettdata: Ik max=xx / Ik min=xxkA
XF01	C10A 2P		Styrestrøm

			Signal til SD NC
--	--	--	---------------------

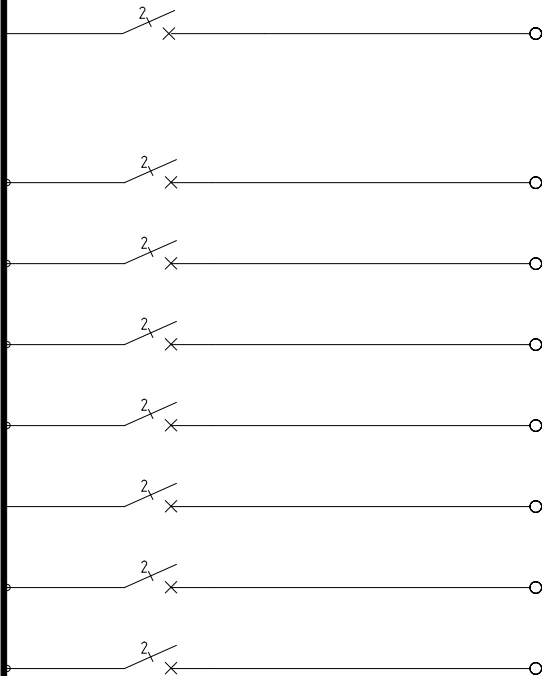

XF02	C10A 2P		Styrestrøm
------	------------	--	------------

XF101	C16A 2P 30mA	-KW101 3G2,5	Varmekabel, uttak, lys/nødlys garderobe 1
XF102	C16A 2P 30mA	-KW102 3G2,5	Varmekabel, uttak, lys/nødlys garderobe 2
XF103	C16A 2P 30mA	-KW103 3G2,5	Varmekabel, uttak, lys/nødlys korridor
XF104	C16A 2P	-KW104 3G2,5	Varme, uttak, lys/nødlys lager/verksted
XF105	C16A 2P	-KW105 3G2,5	Varme, uttak, lys BK og lab.
XF106	C16A 2P	-KW106 3G2,5	Varme, uttak, lys kontrollrom
XF107	C16A 2P		Reserve

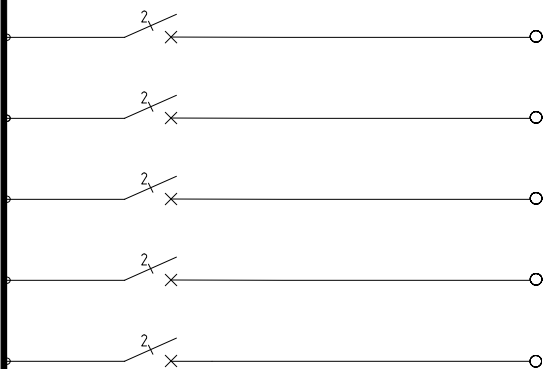

XF201	C16A 2P	-KW201 2X2,5/2,5	Stikk kaffetrakter/minikjøkken kontrollrom dynr osv.
XF202	C16A 2P	-KW202 2X2,5/2,5	Stikk kanal lab
XF203	C16A 2P	-KW203 2X2,5/2,5	Stikk i kanal kontrollrom vannskap
XF204	C16A 2P	-KW204 2X2,5/2,5	Stikk rack
XF205	C16A 2P	-KW205 2X2,5/2,5	VVB

A	29.05.26	Tilbudstegninger			VRBN	CEBP	SILAS
Rev.	Dato	Rev. gjelder	Nr.	Saksb.	Sidem.k	Oppdr.ansv.	
 NORDRE LAND KOMMUNE			TITTEL: Underfordeler + 433.002		SAKSNR. FILNR. TEGN. SAKSB. KONTR. DATO:		
			400V/50Hz		A301529 E433.002 VRBN VRBN CEBP 29.05.26		
			FAG TYPE AVSNITT ETG LØPE.NR BL.NR. REV.				
DVV-E-433.002-60-001_A				1	2	A	

